


1. TRENCH AND BEDDING PREPARATION FOR UNIT

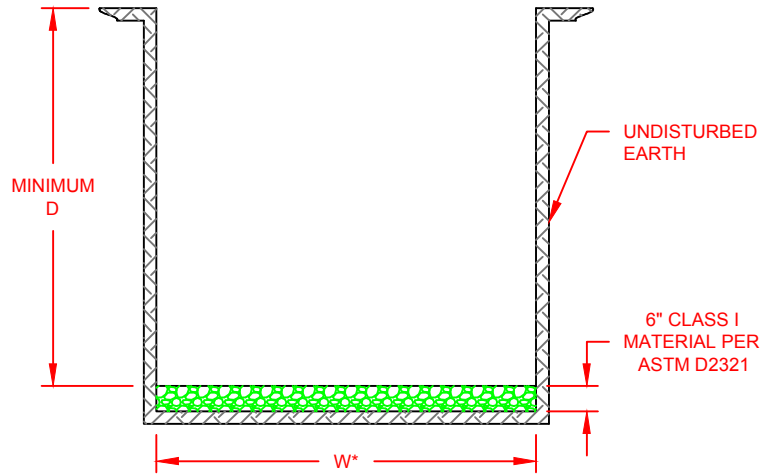


NOTES:

1. AVOID EXCESSIVE GROUND WATER IN THE TRENCH DE-WATER AS NECESSARY.
2. PROVIDE SHEETING OR SHORING AS REQUIRED.
3. MAXIMUM COVER HEIGHT MEASURED FROM THE TOP OF THE UNIT TO FINAL GRADE SHALL NOT EXCEED 8 FEET.
4. MODIFIED TRENCH BOTTOM REQUIRED IF SOFT OR ROCK MATERIAL IS FOUND.

UNIT SIZE	MINIMUM D	MINIMUM W*
36"	4.5'	6.5'
42"	5.0'	7.0'
48"	5.5'	7.5'
60"	7.5'	8.5'

* TRENCH WIDTH DOES NOT ACCOUNT FOR BY-PASS PIPE, THIS ESTIMATE IS FOR THE MAIN UNIT ONLY

2. PLACING UNIT AND INITIAL BACKFILL

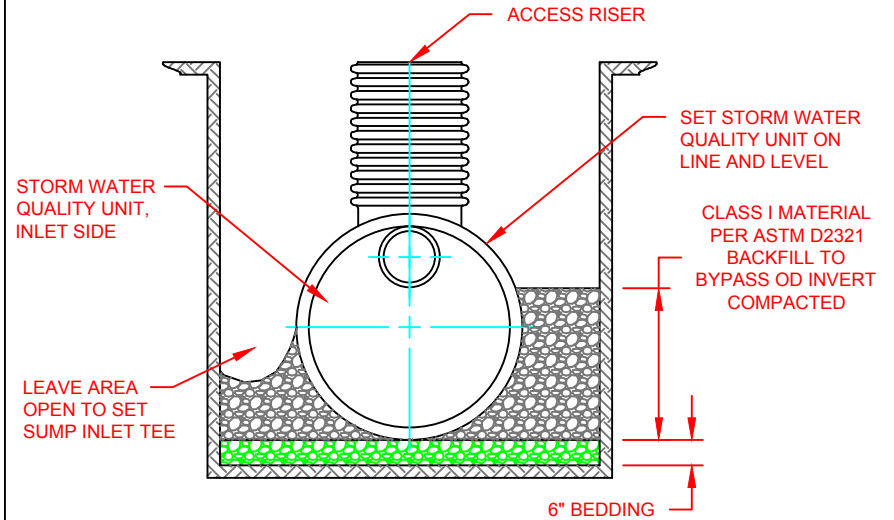

NOTES:

1. UTILIZE CARE WHEN LOWERING UNIT INTO THE TRENCH. HANDLE USING NYLON SLINGS AND TWO PICK POINTS. DO NOT USE SLINGS AROUND RISERS.
2. PLACE BACKFILL AROUND THE UNIT IN UNIFORM 8"-12" LIFTS, COMPACTED.
3. WHEN THE UNIT CONSISTS OF 2 SECTIONS, PLACE THE DOWNSTREAM SECTION FIRST. PROPERLY LUBE THE BELL AND SPIGOT. CONNECT AND HOME THE REMAINING SECTIONS.

© 2016 ADS, INC.

ADVANCED DRAINAGE SYSTEMS, INC. ("ADS") HAS PREPARED THIS DETAIL BASED ON INFORMATION PROVIDED TO ADS. THIS DRAWING IS INTENDED TO DEPICT THE COMPONENTS AS REQUESTED. ADS HAS NOT PERFORMED ANY ENGINEERING OR DESIGN SERVICES FOR THIS PROJECT, NOR HAS ADS INDEPENDENTLY VERIFIED THE INFORMATION SUPPLIED. THE INSTALLATION DETAILS PROVIDED HEREIN ARE GENERAL RECOMMENDATIONS AND ARE NOT SPECIFIC FOR THIS PROJECT. THE DESIGN ENGINEER SHALL REVIEW THESE DETAILS PRIOR TO CONSTRUCTION. IT IS THE DESIGN ENGINEERS RESPONSIBILITY TO ENSURE THE DETAILS PROVIDED HEREIN MEETS OR EXCEEDS THE APPLICABLE NATIONAL, STATE, OR LOCAL REQUIREMENTS AND TO ENSURE THAT THE DETAILS PROVIDED HEREIN ARE ACCEPTABLE FOR THIS PROJECT.

2	FORMATTING UPDATES AND RENAMED	TJR	02/17/16	
REV.	DESCRIPTION	BY	MM/DD/YY	CHK'D

WQU INSTALLATION (TRENCH AND PLACEMENT)

DRAWING NUMBER: STD-511



4640 TRUEMAN BLVD
HILLIARD, OHIO 43026

ADVANCED DRAINAGE SYSTEMS, INC.

DRAWN BY:	MGB
DATE:	7/28/03
CAD BY:	
SCALE:	NTS
SHEET:	OF